NOTES:

1. PLACEMENT OF STOP BOX CAN VARY FROM A MAX OF 5 FT OUTSIDE THE PL TO A MAX OF 5 FT INSIDE THE PL. PLACEMENT OF THE STOP BOX IN THE PUBLIC ROW IS PREFERRED.
2. IF THERE IS A TREE LAWN, BOTH CURB STOP AND METER PIT MUST BE LOCATED BETWEEN CURB AND SIDEWALK.
3. STOP BOX SHALL BE LOCATED IN A LANDSCAPED AREA, 24" FROM THE INLET SIDE OF THE METER PIT UNLESS PRIOR APPROVAL IS OBTAINED FROM CUSTOMER SERVICE FIELD SECTION. FOR CURB STOP LOCATED BENEATH PAVEMENT, USE ROADWAY BOX OVER STANDARD STOP BOX. CURB STOP CANNOT BE LOCATED BENEATH PARKING AREAS.
4. STOP BOX AND METER PIT MUST BE ACCESSIBLE AT ALL TIMES. DO NOT PLACE FENCE, RETAINING WALL OR OTHER OBSTRUCTION WITHIN 2 FT OF STOP BOX OR 5 FT OF METER PIT.
5. METER PIT/VAULT SHALL CONFORM WITH DETAILS ON SHEET 49 OR SHEET 55, AS APPLICABLE.
6. NO BENDS, FITTINGS, CONNECTIONS OR CHANGES IN PIPE SIZE ARE PERMITTED BETWEEN THE TAP AND A POINT WALL OF THE METER PIT.
7. DENVER WATER WILL REPAIR SERVICE LINE LEAKS BETWEEN THE CORPORATION STOP AND THE INLET TO THE CURB STOP ONLY. PROPERTY OWNER IS RESPONSIBLE FOR ALL OTHER SERVICE LINE REPAIRS OR REPLACEMENT FROM THE CORPORATION STOP ON THE WATER MAIN IN THE STREET.

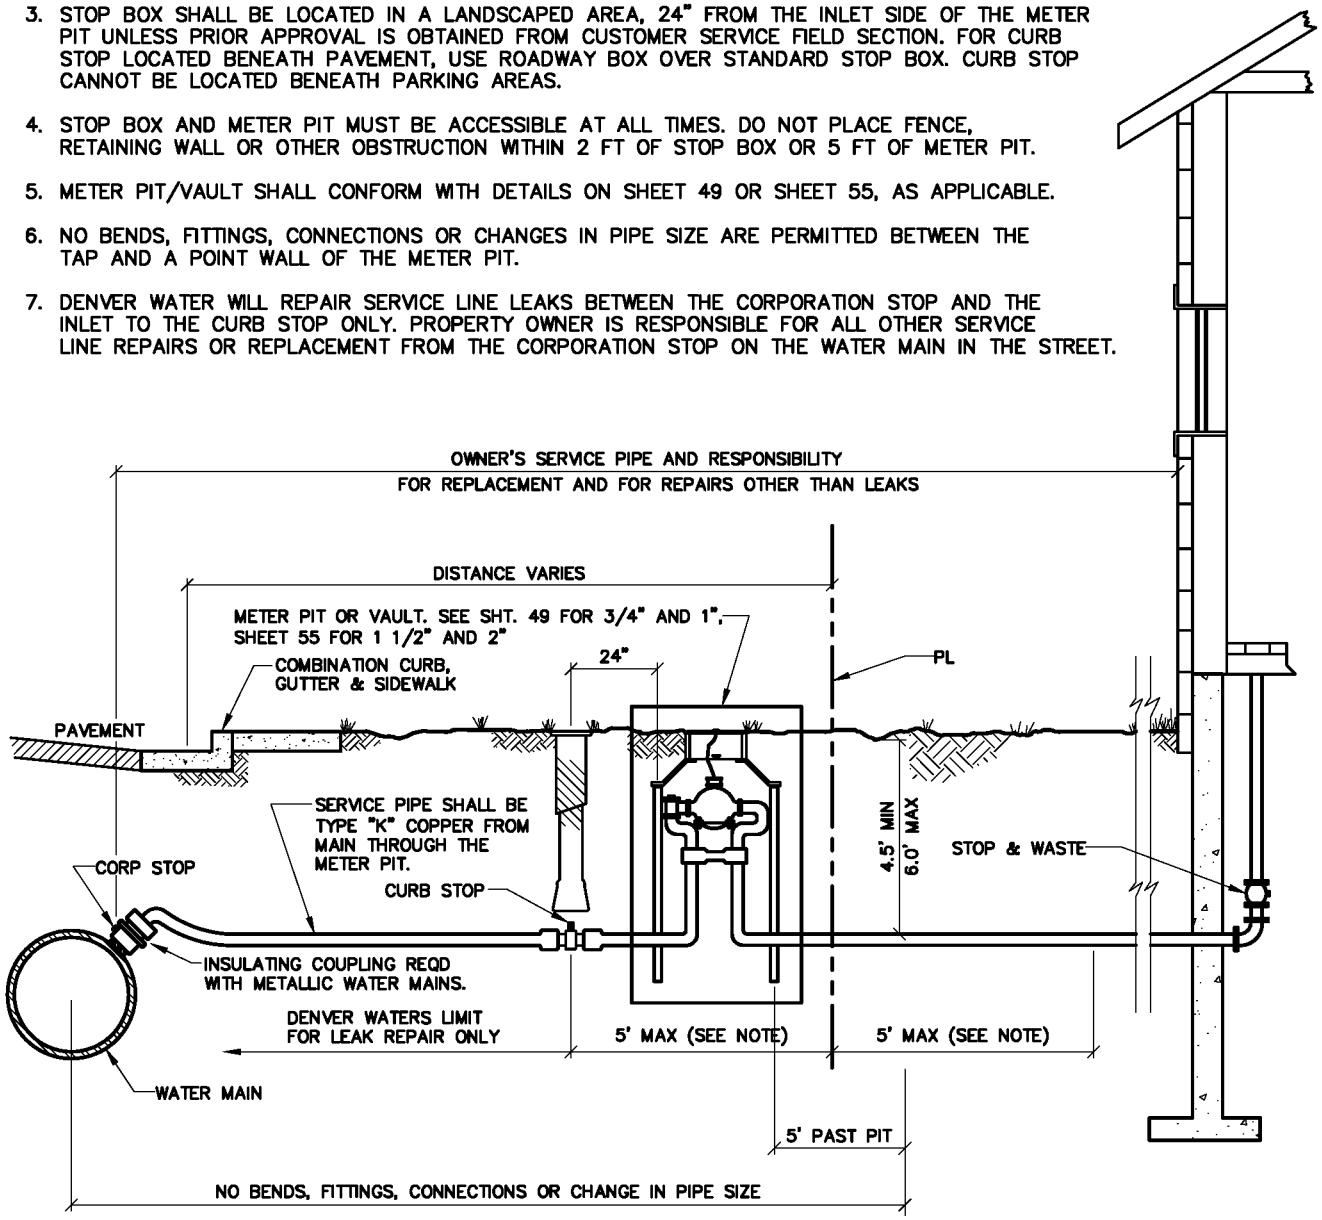

ANY VARIATION FROM THIS STANDARD REQUIRES APPROVAL PRIOR TO INSTALLATION FROM CUSTOMER SERVICE FIELD SECTION.

DENVER WATER
1600 West 12th Avenue • Denver, Colorado 80204
Phone(303)628-6000 • Telecopier No.(303)628-6851

SERVICE LINE, STOP BOX AND OUTSIDE METER INSTALLATION

Scale: NONE	Date: AUGUST 1995	
Drawn: C.B.B.	Tr:	Ck:
Approved:	Dr. 127	No. 35