


APPLICATION 1

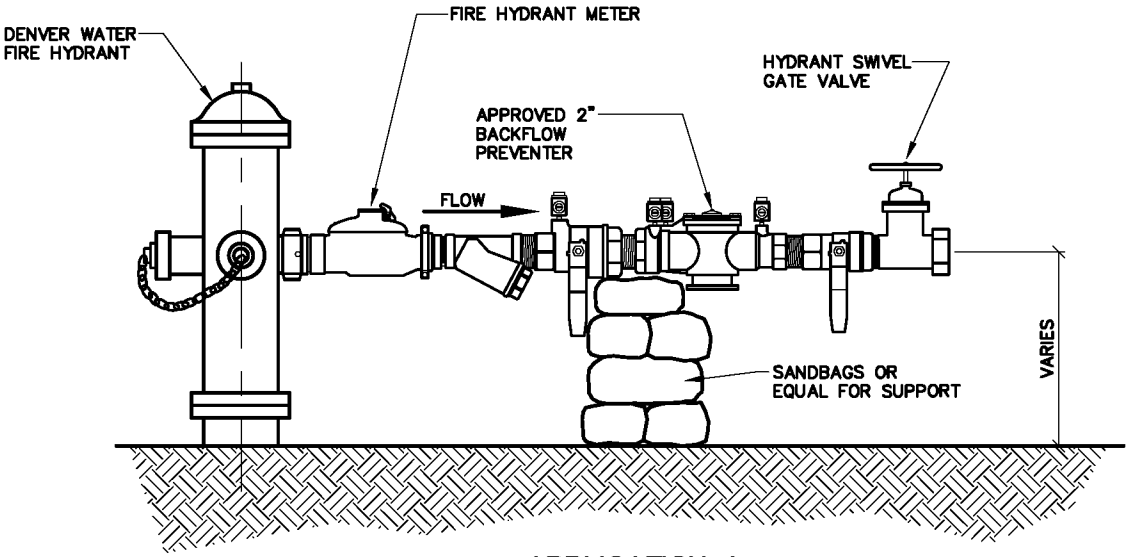


APPLICATION 2

**NOTES:**

1. USE OF HYDRANT REQUIRES VALID HYDRANT USE PERMIT. CONTACT DENVER WATER SALES OFFICE FOR APPLICATION.
2. METER AND RPZ BACKFLOW DEVICE SHALL BE FULLY SUPPORTED WHEN CONNECTED TO FIRE HYDRANT.
3. METER AND RPZ BACKFLOW DEVICE SHALL BE APPROVED BY DENVER WATER. (MS-30) METER MUST BE INSPECTED AND NUMBERED BY DENVER WATER BEFORE BEING PLACED IN SERVICE.
4. METER SHALL BE TESTED ANNUALLY BY DENVER WATER.
5. BACKFLOW DEVICE SHALL BE TESTED ANNUALLY AND COPY OF TEST SHALL BE SENT TO DENVER WATER, BEFORE USAGE WILL BE ALLOWED.
6. CONTRACTOR WILL BE HELD RESPONSIBLE FOR ANY DAMAGE TO FIRE HYDRANT DURING USE.

**DENVER WATER**
1600 West 12th Avenue • Denver, Colorado 80204
Phone(303)628-6000 • Telecopier No.(303)628-6851
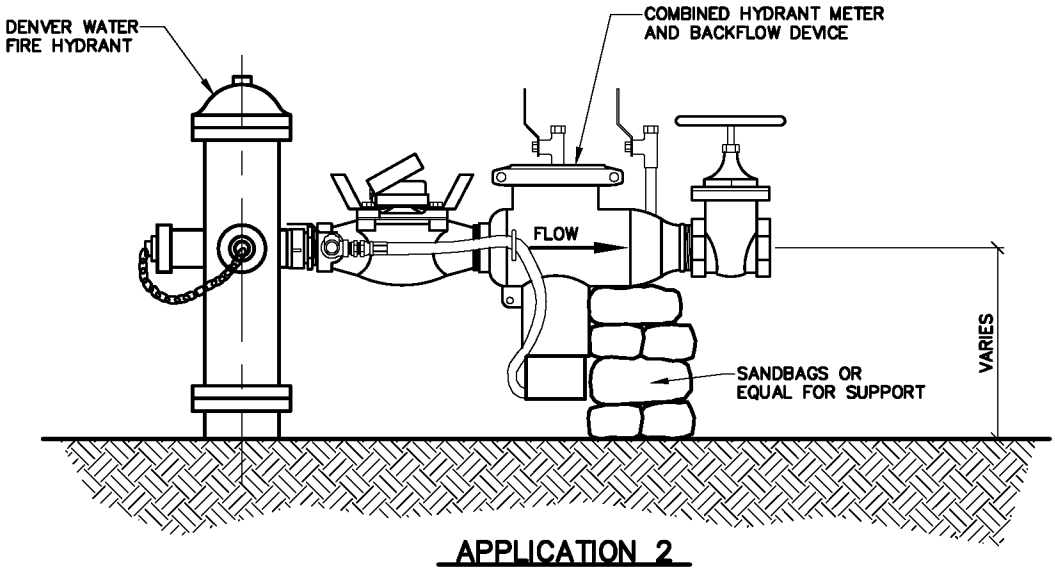
# STANDARD DESIGN FOR HYDRANT METER INSTALLATION

| | | |
|---|---|---|
| Scale: NONE | Date: DECEMBER 1999 | |
| Drawn: C.B.B. | Tr: | Ck: |
| Approved: | Dr. 127 | No. 35 |