



TO METER PIT/VAULT IN LANDSCAPE AREA →

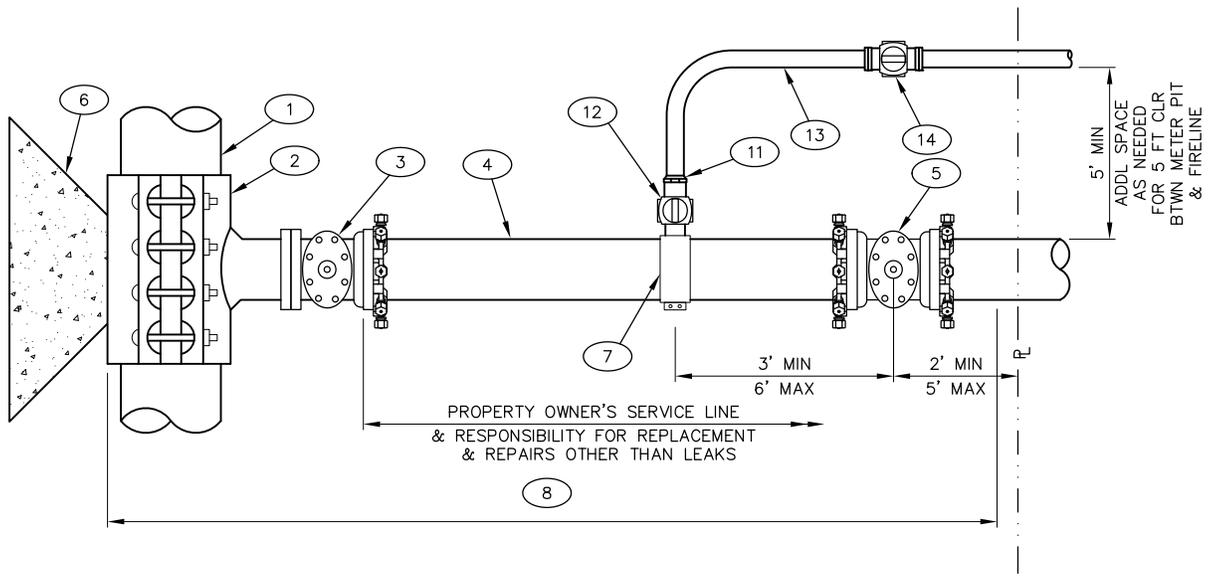

2" & SMALLER DOMESTIC

TO METER VAULT IN LANDSCAPE AREA →

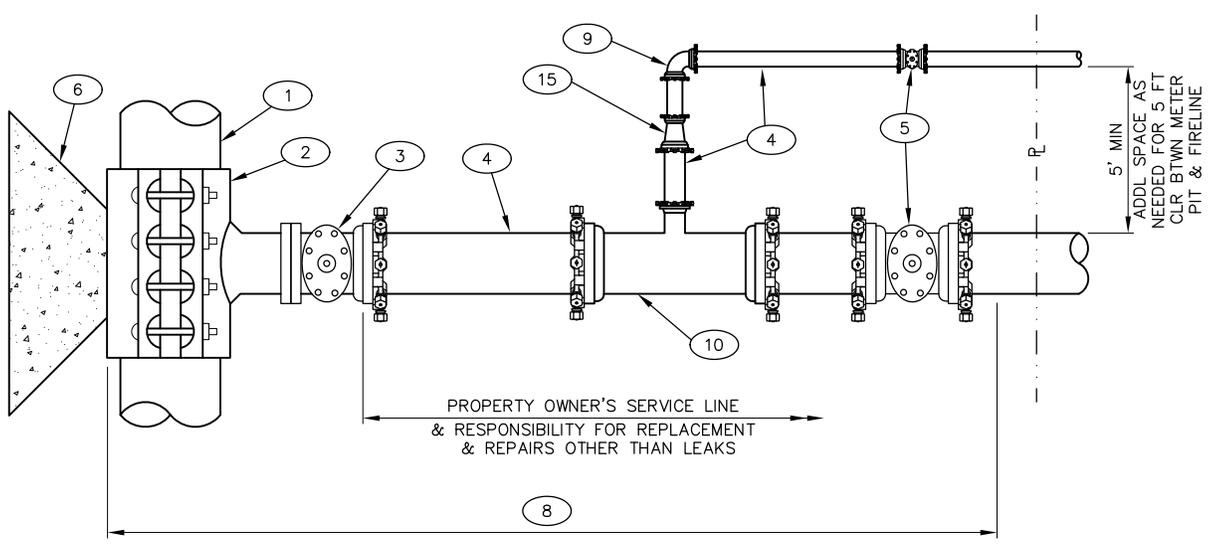

3" DOMESTIC

NOTE:
COMBINATION SERVICE CANNOT BE USED WHERE THE SPACING BETWEEN SERVICES EXCEEDS THE DISTANCE FROM THE MAIN TO THE DOMESTIC TAP OR TEE.

KEY NOTES:

- ① EXIST MAIN
- ② TAPPING SLV OR ANCHORING TEE
- ③ TAPPING VALVE OR MJ GV
- ④ DI PIPE FULLY RESTRAINED
- ⑤ MJ GV
- ⑥ CONC KB
- ⑦ BRASS SERVICE SADDLE
- ⑧ POLYETHYLENE WRAPPED
- ⑨ 90° MJ ELB
- ⑩ MJ TEE
- ⑪ SERVICE INSULATOR
- ⑫ CORP STOP
- ⑬ CU PIPE
- ⑭ CURB STOP
- ⑮ 4"x 3" MJ RDCR

<p>DENVER WATER 1600 West 12th Avenue • Denver, Colorado 80204 Phone (303) 628-6000 • Telecopier No. (303) 628-6851</p>	
<p>FIRELINE CONNECTION WITH DOMESTIC SERVICE TAP</p>	
Scale: <u> NONE </u>	Date: <u> March 2012 </u>
Drawn: <u> C.A.M. </u>	Ck: <u> K ROSS </u>
Approved: <u> [Signature] </u>	Dr. <u> 127 </u> No. <u> 35 </u>