



OPTION 1  
MULTI-PURPOSE PIPING SYSTEM  
(PREFERRED)

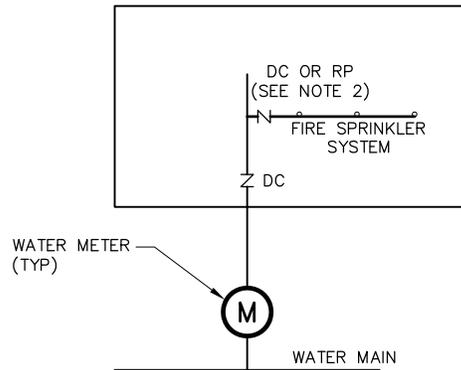

OPTION 2  
BRANCHED

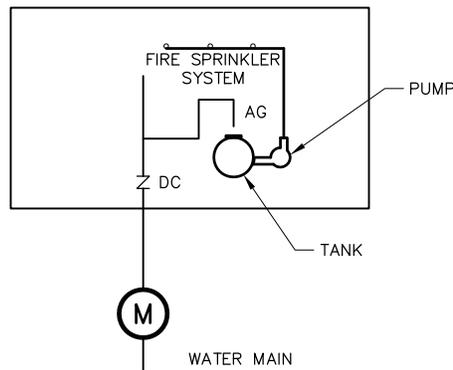

OPTION 3  
TANK

NOTES:

1. MULTI-PURPOSE PIPING SYSTEM TO MEET NFPA 13D REQUIREMENTS; BFPA IS NOT REQUIRED.
2. CHEMICAL ADDITIVES WILL REQUIRE INSTALLATION OF DC OR RP ON SPRINKLER SYSTEM BRANCH LINE. DC OR RP TO BE APPROVED BY DENVER WATER PRIOR TO INSTALLATION.
3. OPTIONS 2 & 3 SHALL BE APPROVED BY DISTRIBUTOR & LOCAL FIRE PROTECTION DISTRICT PRIOR TO APPLICATION FOR WATER SUPPLY LICENSE.
4. OPTION 3 IS NOT APPROVED FOR USE WITHIN DENVER OR TOTAL SERVICE CONTRACT AREAS.
5. AIR-GAP SIZING & ASSOCIATED TANK DETAILS MAY BE REQUIRED BY DENVER WATER PRIOR TO APPROVAL & INSTALLATION.

<b>DENVER WATER</b> 1600 West 12th Avenue • Denver, Colorado 80204 Phone (303) 628-6000 • Telecopier No. (303) 628-6851	
<b>NFPA 13D RESIDENTIAL SPRINKLER SERVICES</b>	
Scale: <u>NONE</u>	Date: <u>March 2012</u>
Drawn: <u>BGS</u>	Ck: <u>K ROSS</u>
Approved: <u>[Signature]</u>	Dr. <u>127</u> No. <u>35</u>