


FLANGED JOINT

ROD

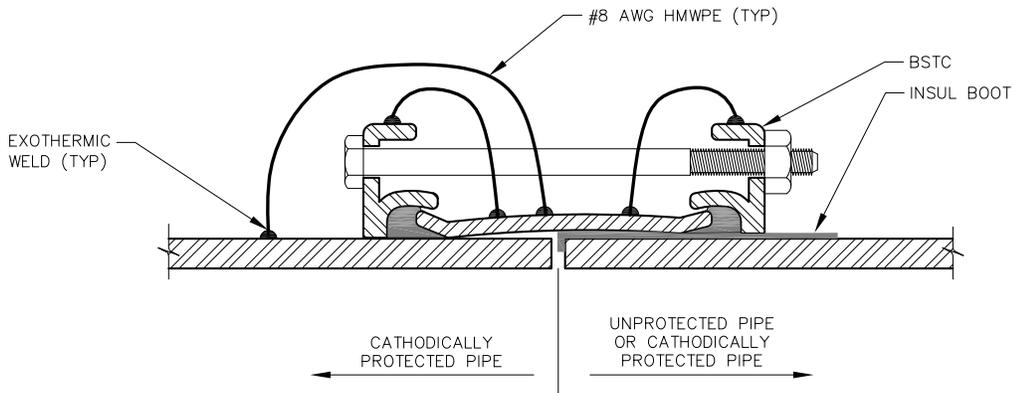

INSULATED BOLTED SLEEVE TYPE COUPLING

NOTES:

1. INSULATED SLEEVES AND WASHERS SHALL BE INSTALLED FROM THE SAME SIDE OF UNPROTECTED FLANGE.
2. BOLT HOLES SHALL BE 1/4" DIAMETER LARGER THAN BOLT DIAMETER AT INSULATING SLEEVES.
3. FIELD COATING NOT SHOWN.

DENVER WATER <small>1600 West 12th Avenue • Denver, Colorado 80204 Phone (303) 628-6000 • Telecopier No. (303) 628-6851</small>	
INSULATED FLANGED JOINTS, RODS, & BOLTED SLEEVE TYPE COUPLINGS	
Scale: <u> NONE </u>	Date: <u> June 2014 </u>
Drawn: <u> C.B.B. </u>	Ck: <u> K ROSS </u>
Approved: <u> [Signature] </u>	Dr. <u> 127 </u> No. <u> 35 </u>