


PLAN

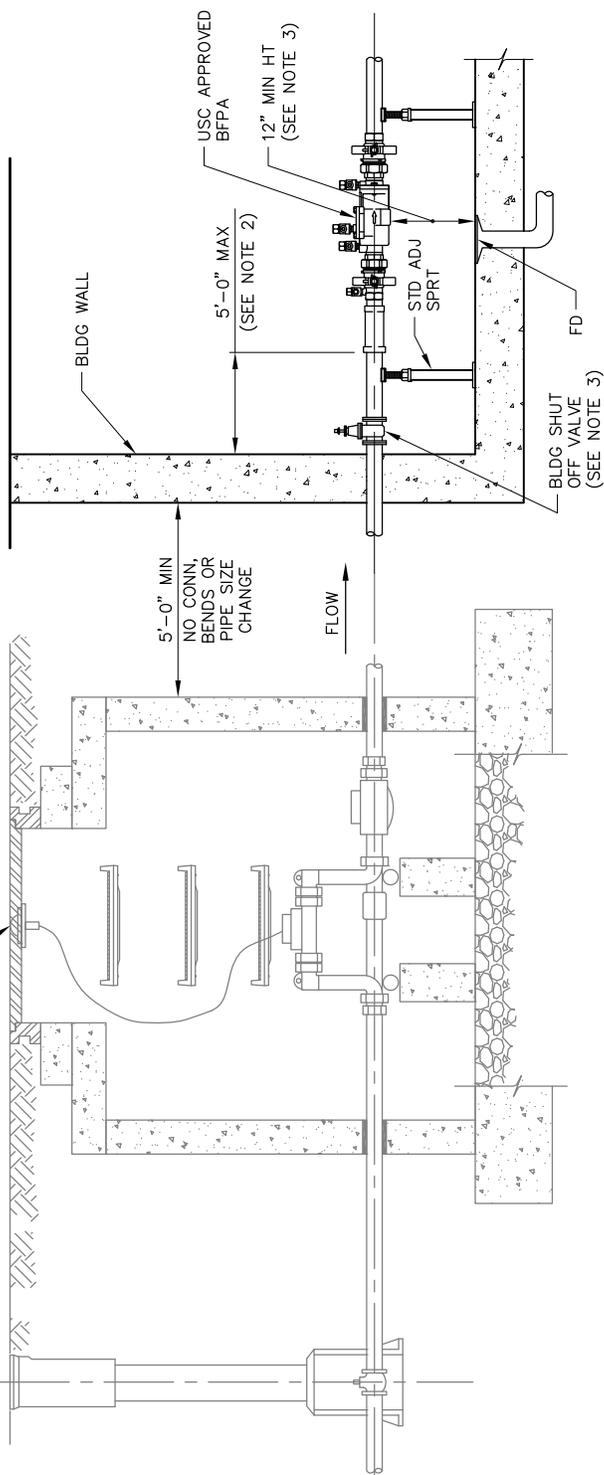

ELEVATION

NOTES:

1. USC APPROVED DOUBLE CHECK VALVE OR REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTION ASSEMBLY SHALL BE OR IS DETERMINED BY THE DEGREE OF HAZARD POSED BY INTERNAL PLUMBING USE.
2. PLACEMENT OF BACKFLOW PREVENTION ASSEMBLY CAN VARY BUT SHALL BE A MAXIMUM OF 5' FROM THE INSIDE WALL OF BUILDING.
3. REFER TO LOCAL CODES & MANUFACTURER REQUIREMENTS FOR INSTALLATION INSTRUCTIONS.
4. INSTALL STANDARD ADJUSTABLE SUPPORTS WITHIN 12" OF INLET & OUTLET ISOLATION VALVES.

DENVER WATER <small>1600 West 12th Avenue • Denver, Colorado 80204 Phone (303) 628-6000 • Telecopier No. (303) 628-6851</small>	
OUTSIDE SETTING FOR 1 1/2" & 2" METER & BYPASS IN MANHOLE WITH INSIDE BACKFLOW PREVENTION ASSEMBLY	
Scale: <u> NONE </u>	Date: <u> March 2012 </u>
Drawn: <u> C.A.M. </u>	Ck: <u> K ROSS </u>
Approved: <u> [Signature] </u>	Dr. <u> 127 </u> No. <u> 35 </u>