


PLAN

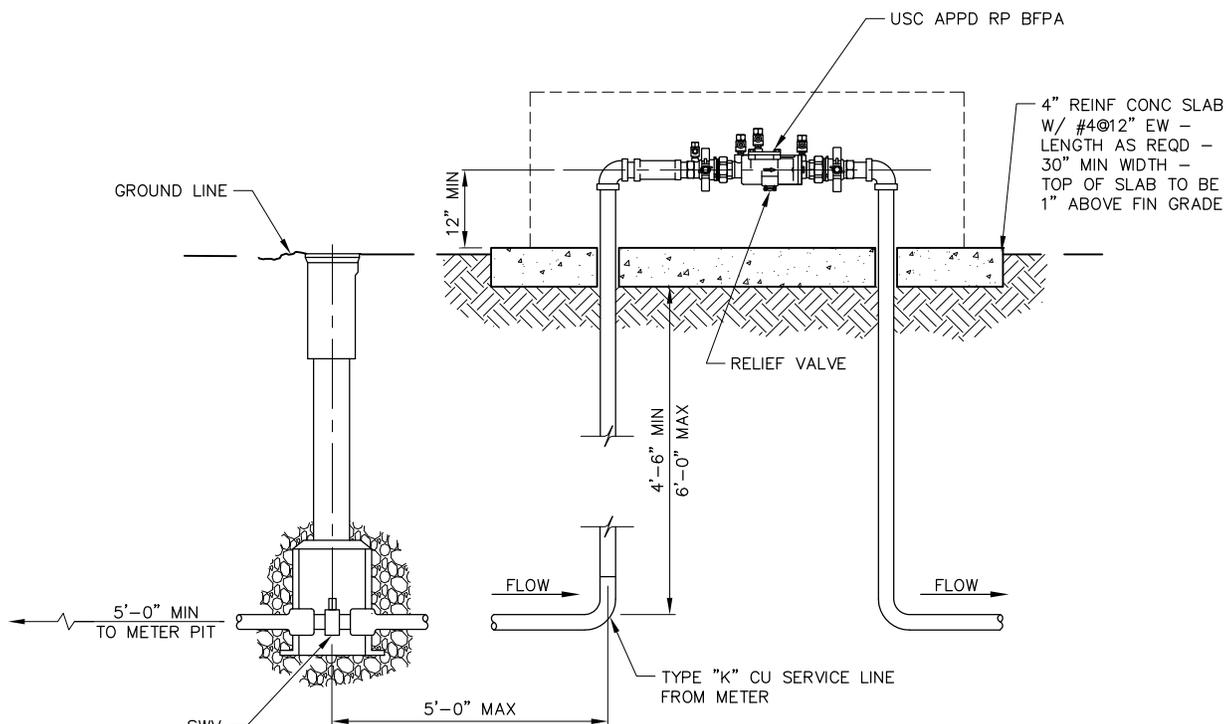

ELEVATION

NOTES:

1. CONCRETE PAD PENETRATIONS SHALL BE 1" LARGER THAN PIPE DIAMETER.
2. DIAMETER OF FITTINGS, NIPPLE, & TUBING SHALL BE EQUAL IN DIAMETER TO THE BACKFLOW PREVENTER.
3. HEATED ENCLOSURE SHALL HAVE SEPARATE APPROVED ELECTRICAL SERVICE & SHALL BE SIZED TO ALLOW ADEQUATE ROOM FOR TESTING AND MAINTENANCE.
4. REFER TO LOCAL CODES & MANUFACTURER REQUIREMENTS FOR INSTALLATION INSTRUCTIONS.

 <p>DENVER WATER 1600 West 12th Avenue • Denver, Colorado 80204 Phone (303)628-6000 • Telecopier No. (303)628-6851</p>	
<p>OUTSIDE SETTING FOR 2" & SMALLER REDUCED PRESSURE PRINCIPLE ASSEMBLY IN ENCLOSURE</p>	
Scale: <u> NONE </u>	Date: <u>February 2013</u>
Drawn: <u> C.A.M. </u>	Ck: <u> K ROSS </u>
Approved: <u><i>[Signature]</i></u>	Dr. <u>127</u> No. <u>35</u>