


PLAN

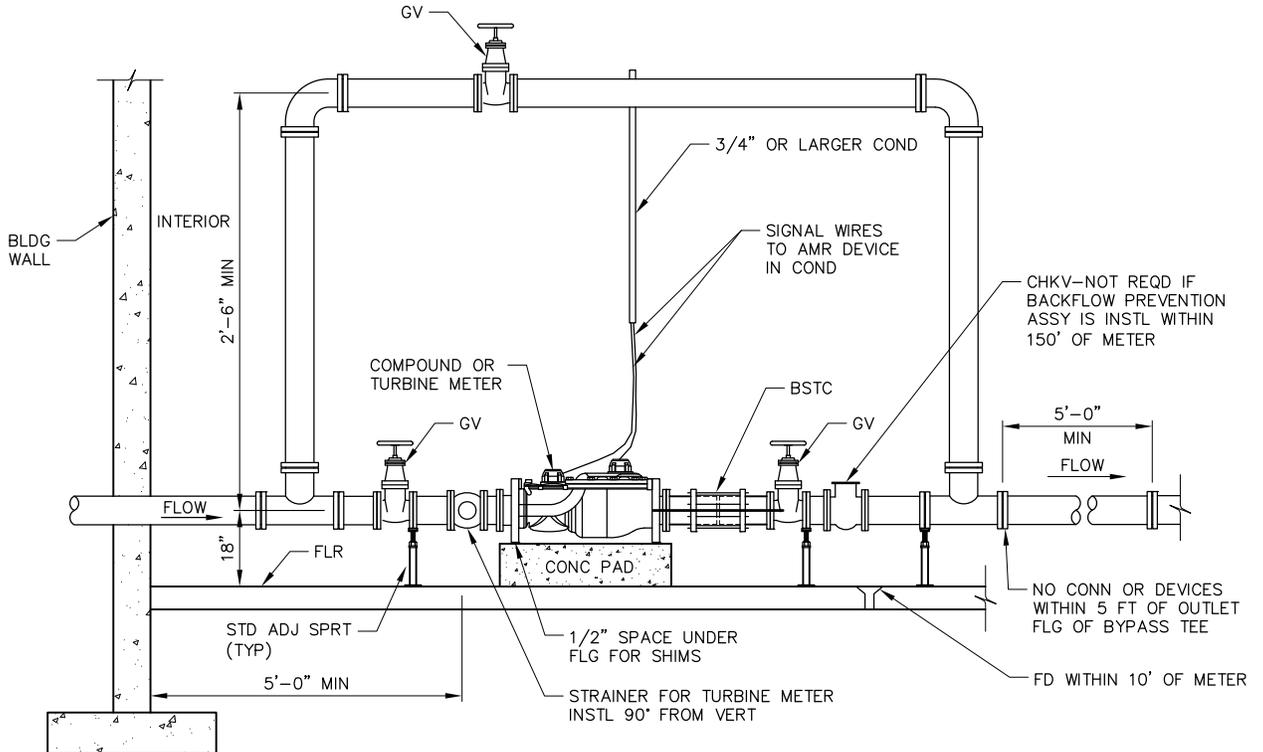

ELEVATION

NOTES:

1. NEW INSIDE METER INSTALLATIONS ARE PERMITTED ONLY BY WRITTEN APPROVAL. EXISTING INSIDE METER INSTALLATIONS MUST COMPLY WITH THIS DRAWING.
2. PIPING FOR 3" & LARGER METERS SHALL BE FLANGED DUCTILE IRON.
3. INSTALLATION MUST ALLOW FOR FULL ACCESS TO THE METER & VALVES & PROVIDE PROTECTION FROM FREEZING WITH A MINIMUM 2' CLEARANCE TO WALL.
4. GATE VALVES SHALL BE NON-RISING STEM, RIGHT HAND OPEN, WITH HAND WHEEL OPERATORS.
5. FOR INSIDE SETTINGS, THE PROPERTY OWNER SHALL PROVIDE A DETAILED DRAWING SHOWING DIMENSIONS OF THE METER ROOM INCLUDING PIPING & EQUIPMENT WITH APPROPRIATE DIMENSIONS FOR DENVER WATER APPROVAL BEFORE CONSTRUCTION.
6. THE TURBINE METER REQUIRES A STRAINER BEFORE THE METER.
7. WALL PENETRATIONS SHALL BE GROUTED WITH CONCRETE.

DENVER WATER 1600 West 12th Avenue • Denver, Colorado 80204 Phone (303) 628-6000 • Telecopier No. (303) 628-6851	
INSIDE SETTING FOR 3" & LARGER METER	
Scale: <u> NONE </u>	Date: <u> March 2012 </u>
Drawn: <u> C.A.M. </u>	Ck: <u> K ROSS </u>
Approved: <u> [Signature] </u>	Dr. <u> 127 </u> No. <u> 35 </u>