APPLICATION FOR WATER SUPPLY LICENSE

DENVER WATER

Denver Water Personnel Only	Application Date:
Premise ID:	Tap/Plan ID Number:

PAYMENT AND SERVICE LINE DIAGRAM IS REQUIRED WITH APPLICATION — ANY USE OF WATER FROM THIS TAP IS PROHIBITED UNTIL THE METER HAS BEEN SET AND INSPECTED.

Application will not be accepted until items 1-4 are fully completed and signed.

1. Property Information

Property Address:			
Bldg./Unit #:	City:		Zip Code:
Subdivision:	Block:	Lot:	Lot Size (Sq.Ft.):

This license application for a _____-inch tap is being applied to serve: (pick one)
tap size

- ❑ Single Family Residence (One tap, one structure)
- ❑ Multi-Family Residence (One tap, one structure, multiple units) *Number of units*: _____
- ❑ Commercial *type of business:* _____
- ❑ Irrigation Only *square feet of irrigable area:* _____
- ❑ Fire Protection Only
- ❑ Other, *please explain* _____
- ❑ Non-potable *please indicate type of use:* _____

This tap will serve irrigation at the property? *yes* ❑ *no* ❑

Are there additional sources of water at this property (well, ditch, etc.)? *yes* ❑ *no* ❑

If yes, what is the additional source? _____

If yes, a soil amendment inspection is required prior to landscaping.
A fine or fee may be assessed for non-compliance.

Any variation in the above described water usage could result in additional fees, fines, and/or interruption of water service.

2. Owner Information

❑ Property Owner ❑ Authorized Agent

Name/Company:	Mailing Address:	
City:	State:	Zip Code:
Phone Number:	Print Name:	
Signature of owner or authorized agent:	Date:	

3. Cross-Connection acknowledgment

This water service may require a backflow prevention assembly (BFPA). Please call Denver Water's Cross Connection Control group at 303-628-5969 to determine the type, model, size and location of the BFPA. Failure to install a BFPA in accordance with Denver Water's Engineering Standards may result in re-inspection charges and added construction cost prior to setting the meter.

I have read and understand the above statement regarding the BFPA _____
Initials

4. Distributor acknowledgment (required only if outside City & County of Denver)

If property to be served is Outside City & County of Denver, the Distributor must complete the following (print form and obtain Distributor's signature):

I authorize a _____ -inch tap to be attached to _____ facilities.
Size *Name of Distributor*

_____ _____
Distributor Representative's Signature and title Date

_____ _____
Print Name Contract number

This Water Supply License application is made under and subject to the following conditions:

- This License application is subject to the Charter of the City and County of Denver acting by and through its Board of Water Commissioners ("Board"), Operating Rules and Engineering Standards as they may be changed from time to time.
- When approved by the Board, this document constitutes a License to receive water service at the above property address within its legally described boundaries from the system owned, operated or served by the Board.
- The OWNER/AUTHORIZED AGENT is the owner of the premise described herein or is the authorized agent of the owner.
- Water service is limited to water available under the conditions which exist from time to time. The Board DOES NOT GUARANTEE to maintain conditions such that the premise can receive uninterrupted supply of water. The Board accepts no responsibility for the size, connection, pressure, location, or method of operation of any distribution mains or service lines not owned and operated by the Board.
- The tap must be reasonably sized in relation to the size and use of the licensed property in the judgment of Denver Water.
- Charges due accrue against the property. Water service may be suspended whenever any charge is past due. Service may also be suspended, and this License may be deactivated or revoked for violations of Denver Water's Operating Rules.
- OWNER/AUTHORIZED AGENT agrees to pay such rates, fees and charges, as established by the Board from time to time.
- The OWNER/AUTHORIZED AGENT understands the Water Supply License must be activated as required in the Operating Rules and Engineering Standards of the Board in order to receive water.

If property is inside the City & County of Denver, contact Denver Waste Water Management Office at 303-446-3500 for information and charges for your waste water service.

Submit this form

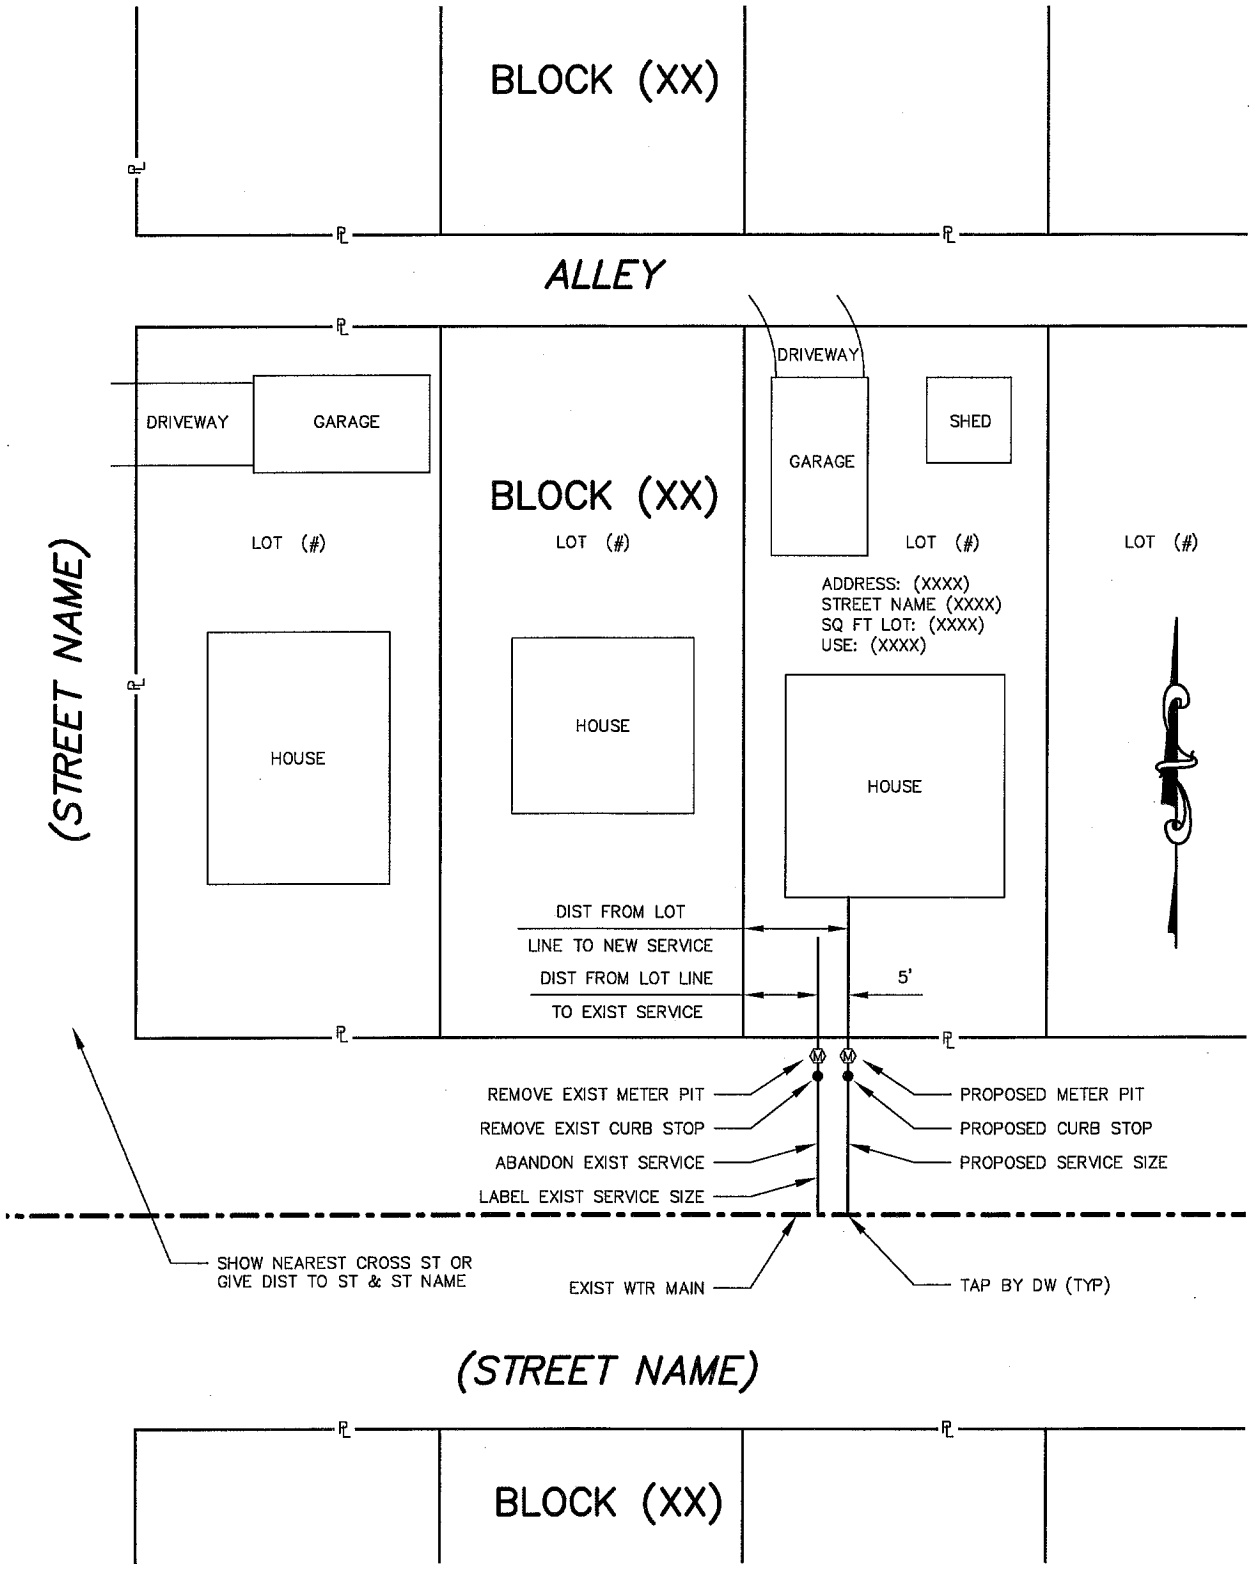

NOTES:

1. PLEASE INCLUDE THE FOLLOWING IN YOUR DIAGRAM:
   - PROPOSED ADDRESS
   - WHERE THE PROPOSED STRUCTURE(S) ARE LOCATED ON LOT
   - DRIVEWAY LOCATION
   - LOCATION OF THE PROPOSED TAP, CURB STOP & METER
   - PROPOSED USAGE (IE RESIDENTIAL, COMMERCIAL ETC).

2. IF THERE ARE ANY EXISTING STRUCTURES, PLEASE ALSO INCLUDE THE FOLLOWING:
   - EXISTING ADDRESS.
   - WHERE EXISTING STRUCTURE(S) SIT ON THE LOT.
   - LOCATION OF EXISTING TAP AND METER, LABEL DISTANCE FROM LOT LINES.

DENVER WATER

(EXAMPLE) 2" & SMALLER SINGLE FAMILY SERVICE LINE PLAN

Scale: NONE	Date: May 2015
Drawn: RLB	Ck: K ROSS
Approved:	Dr. XX No. XX

SHEET RDV_SF